

Brunswick Regional



Water and Sewer

**SPECIFICATIONS FOR WATER HOOK UP ON THE OWNER SIDE OF THE METER BOX, POTABLE WATER AND IRRIGATION WATER**

IF YOU **DO NOT** COMPLY WITH THESE REGULATIONS THE DISTRICT **CAN NOT** TURN YOUR WATER ON.

1. It is **illegal** to connect a private water supply to the Brunswick Regional Water & Sewer lines in any manner. The line between the meter box and the house **must not be connected** in any manner to another water supply. A "T" with gate valves on all three (3) sides is not acceptable. This is NC State law and any cross connection is subject to a \$1,000.00 fine. A cross connection is any connection directly or indirectly to the District's line that may flow water from another source.
2. Upon installation the line must be uncovered for approximately three (3) feet from the meter box in order for a Service Representative from the District to see the physical connections and how they were installed. The Representative **will not** uncover a line to check these connections.
3. A **brass** nipple and gate or ball valve must be installed immediately after the meter box and the valve left in the 'off' position until the connection has been inspected and is accepted by the District.
4. The valve in #3 above is to be followed by a brass nipple and a Backflow Preventer. Backflow preventers for domestic water service are to be #7 Watts or equal. Backflow preventers for irrigation service are to be Watts #9, Zurn/Wilkins 975XL or equal. These are brass valves, and the Model Number must be facing upright for inspection. **(PVC valves are not acceptable)**
5. The line must have approximately 12 inches of cover.
6. A pressure-reducing device is recommended by the District but is not mandatory. The District will not be responsible for any excess pressure that may occur.
7. All tap fees, impact fees and security deposits must be paid, and all paperwork completed before the District can install a water meter.
8. Billing for water service begins the date the meter is installed or within sixty days after the requested service was made available. (tap and meter box installed)

There will be a **\$50.00** service call fee for each additional trip the District's Service Representative must make if these guidelines are not followed.


SERVICE ADDRESS	LOT NUMBER
DATE	SIGNATURE

**Headquarters Address**  
516 Village Road, NE Leland, NC 28451  
**Office:** 910-371-9949

**Mailing Address**  
P.O. Box 2230, Leland, NC 28451  
**Fax:** 910-371-6441

# Brunswick Regional Water and Sewer H2GO

## Materials & Specifications for Connecting Domestic Service Lines Only

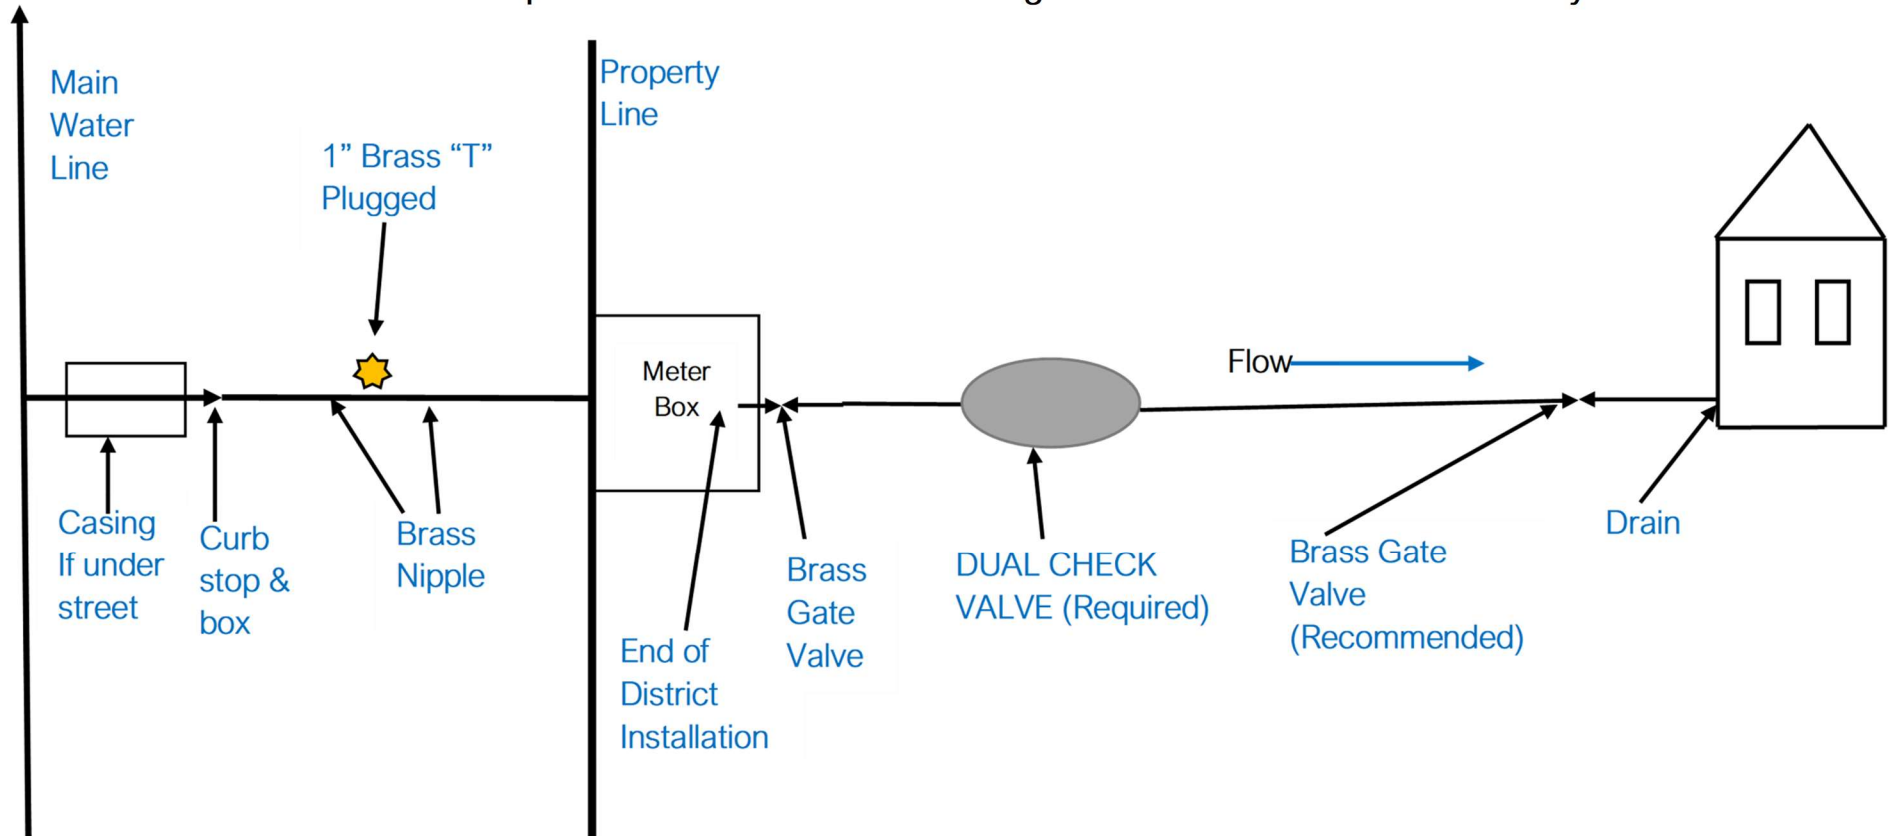

Note: District provides and installs up to and including the meter box. Customer is responsible for all installation after the meter box.

**Brass Gate Valve and Dual Check Valve are required.** Pressure Reducer, Gate Valve and Drain Down Valve at the home are recommended

### IMPORTANT

- ✓ Pipes **must** be completely disconnected, not just shut off from the well to the house. Well water can still be used for non-household use (i.e. watering lawns, washing cars, etc.)
- ✓ Pressure reducing devices should be used in lines from the meter to the house. The District does not regulate nor control household pressure and it not responsible for any damage by excessive pressure.
- ✓ Use pipe suitable for up to **160 psi** working pressure with a water temperature of up to **73 degrees**, buried a minimum of **12 inches** below grade level.